

RAMSES 705

Item no.: 7050001

theben

Climate control
Room thermostats

Description

- Room temperature controller with thermal feedback
- Switch for heating ON/OFF
- Suitable for all types of heating, e.g. gas, water, electric heating with central/individual room control
- Setting controller with mechanical setting limit or detection



Technical data

| RAMSES 705 | |
|---------------------------|---|
| Operating voltage | 230 – 240 V AC |
| Frequency | 50 – 60 Hz |
| Type of contact | NC contact |
| Switching capacity | 10 A (at 230 V AC, $\cos \varphi = 1$), 4 A (at 230 V AC, $\cos \varphi = 0.6$) |
| Setting range temperature | 5°C ... 30°C |
| Function | Mechanical |
| Hysteresis | - |

| RAMSES 705 | |
|--------------------|------------------------------------|
| Control accuracy | approx. 1 K, thermal recirculation |
| Test approval | VDE |
| Colour | White |
| Installation type | Surface-mounted |
| Type of protection | IP 30 |
| Protection class | II according to EN 60 730-1 |

Subject to technical changes and misprints

additional information at: www.theben.de/product/7050001


The load data are determined with exemplary selected illuminants and are therefore typical data due to the large number of available products.

RAMSES 705


Item no.: 7050001

theben

Connection example

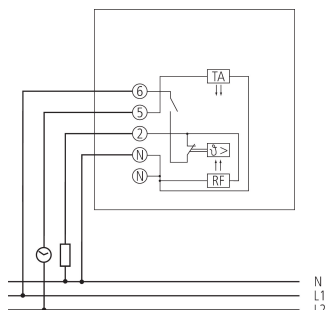

Scale drawings

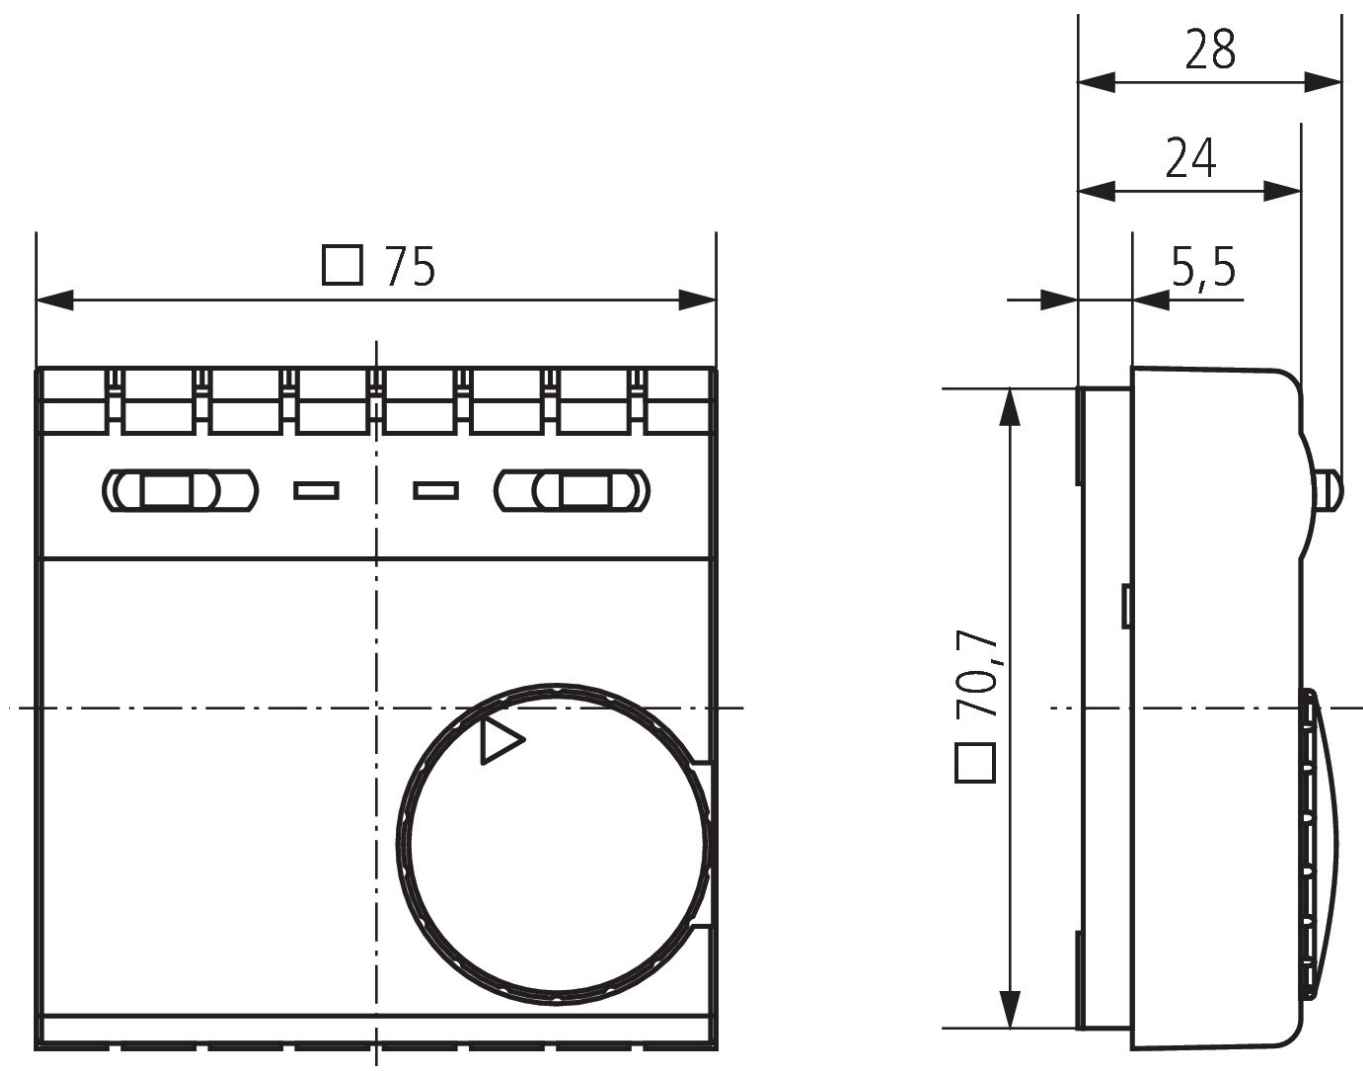

Subject to technical changes and misprints

additional information at: www.theben.de/product/7050001

The load data are determined with exemplary selected illuminants and are therefore typical data due to the large number of available products.

05/08/2022

Page 2 of 3

RAMSES 705


Item no.: 7050001

theben

Accessories

Adapter plate RAMSES 70x

Item no.: 9070480

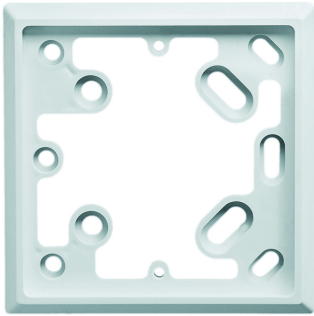

Actuator ALPHA 5 230 V

Item no.: 9070441



Subject to technical changes and misprints

additional information at: www.theben.de/product/7050001

The load data are determined with exemplary selected illuminants and are therefore typical data due to the large number of available products.

05/08/2022

Page 3 of 3